Датчик перепада давления


PSE550

Предназначен для контроля перепада давления.

- Аналоговый выходной сигнал 1 ~ 5 В или 4 ~ 20 мА
- Высокая точность и линейность характеристик
- Компактная конструкция
- Встроенный индикатор
- Может использоваться совместно с контроллером PSE300
- Степень защиты ІР40

Технические характеристики


Номер для заказа		PSE550	PSE550-28		
Диапазон измеряемого перепада давлений (кПа)		0~2			
Рабочий диапазон давлений (кПа)		-50 ~ 50			
Испытательное давление (кПа)		65			
Рабочая среда		Сжатый воздух, некоррозионные газы			
Напряжение питания		12 ~ 24 VDC (колебания напряжения ±10%)			
Потребление тока (мА)		≤ 15			
Аналоговый выход		1 ~ 5 B, выходное сопротивление 1 кОм	4 ∼ 20 мА, макс. сопротивление нагрузки 100 Ом (при 12 VDC) и 500 Ом (при 24 VDC)		
Погрешность измерений	Погрешность измерений		≤ ± 1% (от полного диапазона при температуре +25°±3°С)		
Линейность		\leq \pm 0.5% (от полного диапазона)			
Воспроизводимость		\leq \pm 0.3% (от полного диапазона)			
Чувствительность к колебаниям напряжения питания		≤ ± 1% для напряжения 12 ~24 В пост.тока			
Степень защиты		IP40			
Диапазон температур (°C)	Рабочих	0 ~ 50			
	Хранения	-20 ~ 70			
Напряжение пробоя изоляции		Между внешним контактом и корпусом 1000 VAC, 50/60 Гц в течение 1 мин.			
Сопротивление изоляции		50 МОм между внешним контактом и корпусом (при 50 VDC)			
Устойчивость к вибрациям		10 ~ 150 Гц с амплитудой до 1.5 мм или с ускорением 98 м/c² в трех измерениях в течении 2 часов (в выключенном состоянии)			
Устойчивость к ударам		300 м/с ² в трех измерениях, не более 3 раз в каждом измерении			
Кабель		3-хпроводный кабель; 3м; 0.15мм ²	2-хпроводный кабель; 3м; 0.15мм²		
Влияние температуры 1)		$\leq \pm 3\%$ (от полного диапазона) при 25°C)			
Присоединение		Ø4.8 (под трубку с внутр. диаметром 4 мм)			
Bec (r)		75 (с кабелем)			





Примеры применения

Контроль расхода воздуха в вентиляционной системе






Контроль уровня жидкости



Размеры

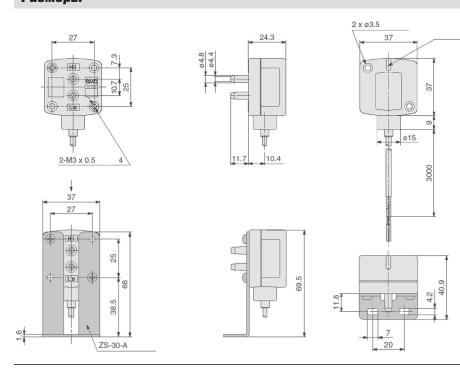

Электрическая схема и схема подключений

РЅЕБ50 Вход 1~5 В Коричневый Чёрный Дерный Нагрузка Синий





Нагрузку можно подключать как к "+" так и к "-"

Принадлежности (заказываются отдельно)


Крепежный угольник **ZS-30-A**

Low Differential Pressure Sensor Series PSE550/300

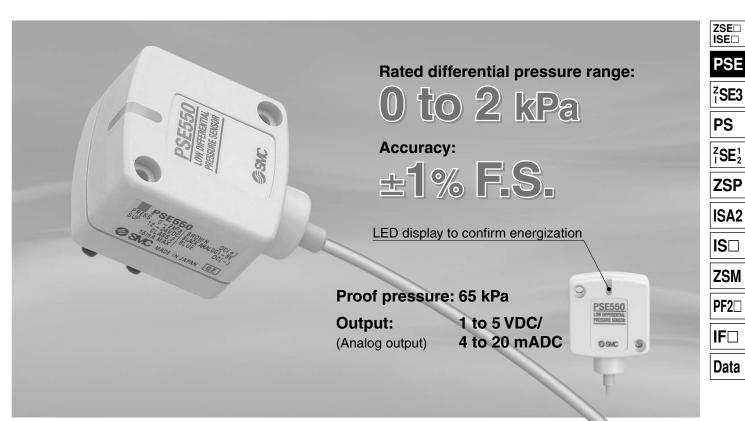


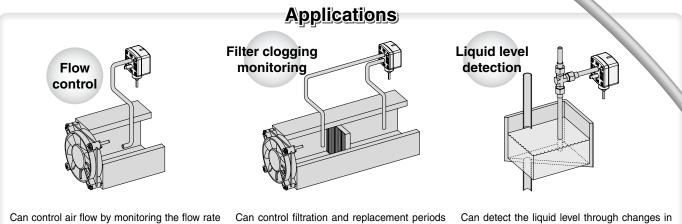

by monitoring the clogging of the filter.

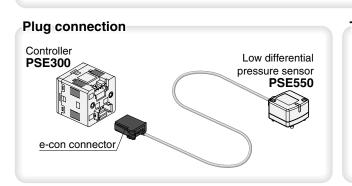

inside the duct.




the purge pressure.





Low Differential Pressure Sensor Series PSE550

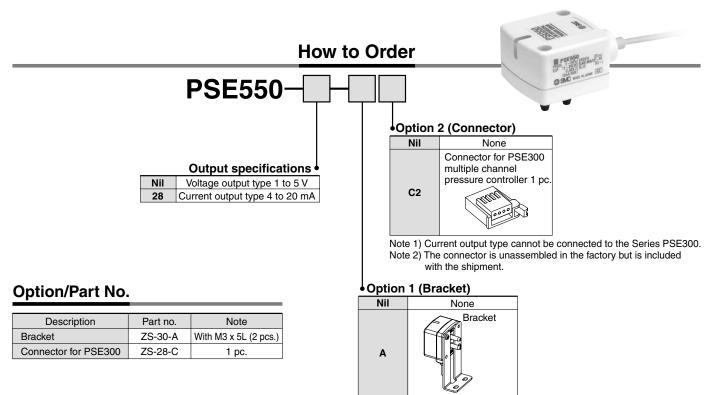

Note) The bracket is unassembled in the factory, but is included with the shipment.

Specifications


	Model	PSE550	PSE550-28			
Rate	d differential pressure range	0 to 2 kPa				
Oper	ating pressure range					
Proof	pressure	65 kPa				
Appli	cable fluid	Air/Non-corrosive gas/Non-inflammable gas				
Powe	r supply voltage	12 to 24 VDC ±10%, Ripple (p-p) 10% or less (With power supply polarity protection)				
Curre	ent consumption	15 mA or less	_			
Output specification		Analog output 1 to 5 VDC	Analog output 4 to 20 mADC (Within rated differential pressure range)			
		(Within rated differential pressure range)	Allowable load impedance:			
		Output impedance: Approx. 1 $k\Omega$	500 Ω or less (at 24 VDC)			
			100 Ω or less (at 12 VDC)			
Accuracy (Ambient temperature of 25°C) ±1		±1% F.S				
Linearity		±0.5% F.S. or less				
	atability	±0.3% F.S. or less				
Indication light		Orange light is on (When energized)				
ခွ	Enclosure	IP40				
star	Operating temperature range	Operating: 0 to 50°C, Stored: –20 to 70°C (No freezing or condensation)				
Enclosure		Operating/Stored: 35 to 85% RH (No condensation)				
ੁੱਲ Withstand voltage		1000 VAC or more, 50/60 Hz for 1 minute between live parts and case				
l ent	Insulation resistance	50 M Ω or more between live parts and case (at 500 VDC)				
Withstand voltage Insulation resistance Vibration resistance	Vibration resistance	10 to 150 Hz at whichever is smaller of 1.5 mm amplitude or 100 m/s² acceleration,				
	ibration resistance	in X, Y, Z directions, for 2 hours each (De-energized)				
ᇤ	Impact resistance	300 m/s ² in X, Y, Z directions, 3 times each (De-energized)				
Temp	erature characteristics	±3% F.S. or less (Based on 25°C)				
Port size		ø4.8 (ø4.4 in the end) resin piping				
		(Applicable to I.D. ø4 air tubing)				
Material of wetted parts		Resin pipe: Nylon, Piston area of sensor: Silicon				
Sensor cable		3-wire oval cable (0.15 mm²)	2-wire oval cable (0.15 mm²)			
Weigl	With sensor cable	75 g				
vveigi	Without sensor cable	35 g				


Note) Can detect differential pressure from 0 to 2 kPa within the range of -50 to 50 kPa.



Low Differential Pressure Sensor Series PSE550

Analog Output





ZSE□ ISE□

PSE

ZSE3

PS

ZSP

ISA₂

IS□

ZSM

PF2□


IF□

Data

Internal Circuit


PSE550

Voltage output type 1 to 5 V Output impedance Approx. 1 k Ω




PSE550-28


Current output type 4 to 20 mA Allowable load impedance 500 Ω or less (at 24 VDC) 100 Ω or less (at 12 VDC)




* Install the load either on the LINE (+) or LINE (-) side.


Dimensions







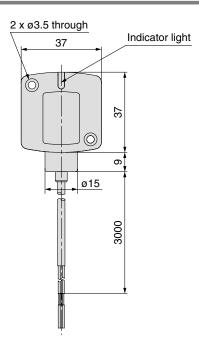

With bracket







Series PSE



Specific Product Precautions 1

Be sure to read before handling.

Sheath

1

2

3

20 mm or more

Wire core color

For PSE300 (ZS-28-C)

Brown (DC (+))

Not connected

Blue (DC (-))

Insulator

Part-A

Pressure Sensor

Handling

∕!\ Warning


- 1. Do not drop, bump, or apply excessive impact while handling. Although the body of the sensor may not be damaged, the inside of the sensor could be damaged and lead to malfunction.
- 2. The tensile strength of the cord is 50 N or less. Applying a greater pulling force to it can cause malfunction. When handling, hold the body of the sensor—do not dangle it from the cord.
- 3. Care should be taken when stripping the outer cable covering as the insulator may be accidentally torn or damaged if incorrectly stripped, as shown on the right.
- 4. Do not use pressure sensors with corrosive and/or flammable gases or liquids.
- 5. Connection of sensor connector
 - · Cut the sensor cable as illustrated to the right.
 - · Referring to the table below, insert each lead wire of the cable at the position marked with a number corresponding to the color Connector of the lead wire.
 - · Confirm that the numbers on the connector match the colors of the wires and that the wires are inserted to

Black (OUT: 1 to 5 V) the bottom. Press Part A by hand for temporary fixing.

· Press in the central part of Part A vertically with a tool such as pliers.

 A sensor connector cannot be taken apart for reuse once it is crimped. If the wire arrangement is incorrect or if the wire insertion fails, use a new sensor connector.

 For connection to SMC Series PSE300 pressure switches. use sensor connectors (ZS-28-C) or econ connectors listed below.



Manufacturer	Part no.	
Sumitomo 3M	37104-3101-000FL	
Tyco Electronics AMP	1-1473562-4	
OMRON Corporation	XN2A-1430	

- For detailed information about e-con connectors, please consult the manufacturers of the respective connectors.
- When piping, increase the length of the air tubing to allow for any possible warping, increased tension or moment load or increased tension, etc.
- In cases where SMC air tubing is not used, make sure the product has similar I.D. accuracy within $\emptyset 4 \pm 0.3$ mm.

Handling

- · Make sure that the air tubing is firmly inserted to avoid possible disconnection. (Tensile strength is approx. 25 N when being inserted 8 mm.)
- Please consult with SMC if you intend to use with fluids other than air, non-corrosive gas and non-inflammable gas.

Operating Environment


\land Warning

- 1. The pressure sensors are CE marked; however, they are not equipped with surge protection against lightening. Lightning surge countermeasures should be applied directly to system components as necessary.
- 2. The pressure sensors do not have an explosion proof rating. Never use pressure sensors in the presence of flammable or explosive gases.

Piping Connection

∕!\ Caution

- · Cut the air tubing vertically.
- · Carefully hold the air tubing and slowly push it into the resin pipe, ensuring that it is inserted by more than 8 mm. For your information, the tensile strength is approx. 25 Resin pipe N when inserted by more than 8 mm.



• Insert the low pressure tubing into "Lo" pipe, and the highpressure tubing into "Hi" pipe.

Controller

Handling

∕!\ Warning

- 1. Do not drop, bump, or apply excessive impact (100 m/s²) while handling. Although the body of the controller case may not be damaged, the inside of the controller could be damaged and cause malfunction.
- 2. The tensile strength of the power supply/output connection cable is 50 N; that of the pressure sensor lead wire with connector is 25 N. Applying a greater pulling force than the applicable specified tensile strength to either of these components can lead to malfunction. When handling, hold the body of the controller.



PSE SE3

PS

ZSE:

ZSP

ISA₂

IS□

ZSM

PF2□

 $\mathsf{IF}\Box$

Data

Series PSE



Specific Product Precautions 2

Be sure to read before handling.

Controller

Connection

⚠ Warning

- Incorrect wiring can damage the switch and cause malfunction or erroneous switch output. Connections should be done while the power is turned off.
- 2. Do not attempt to insert or pull out the pressure sensor or its connector when the power is on. Switch output may malfunction.
- 3. Wire separately from power lines and high voltage lines, avoiding wiring in the same conduit with these lines. Malfunctions may occur due to noise from these other lines.
- 4. If a commercial switching regulator is used, make sure that the F.G. terminal is grounded.

Operating Environment

⚠ Warning

- 1. Our pressure sensor controllers are CE marked; however, they are not equipped with surge protection against lightning. Lightning surge countermeasures should be applied directly to system components as necessary.
- 2. Our pressure sensor controllers do not have an explosion proof rating. Never use pressure sensors in the presence of flammable or explosive gases.


Mounting

⚠ Caution

1. Mounting with bracket


Mount the bracket on the body with two M3 \times 5L mounting screws.

Tighten the bracket mounting screws at a tightening torque of 0.5 to 0.7 N·m.



2. Mounting with panel mount adapter

Secure the panel mount adapter with two M3 x 8L mounting screws.

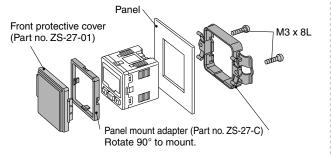


Mounting

3. Panel mount adapter removal


To remove the controller with panel mount adapter from the equipment, remove the two mounting screws, and pull out the controller while pushing the claws outward.

Failure to follow this procedure can cause damage to the controller and panel mount adapter.




Wiring

- 1. Connection and removal of sensor connector
 - Hold the lever and connector body with two fingers and insert the connector straight into the pin until it is locked with a click sound.
 - To remove the connector, pull it out straight while pressing the lever with one finger.



2. Connector pin numbers for power supply/output





Series **PSE**

Specific Product Precautions 3

Be sure to read before handling.

Set Differential Pressure Range & Rated Differential Pressure Range

⚠ Caution

Set the pressure within the rated differential pressure range.

The set differential pressure range is the range of differential pressure that can be set on the controller. The rated differential pressure range is the range of differential pressure that satisfies the specifications (accuracy, linearity, etc.) of the sensor.

Although it is possible to set a value outside the rated differential pressure range, the specifications will not be guaranteed even if the valve stays within the set differential pressure range.

Sensor		Pressure range					
		−2 kPa	0	2 kPa	5 kPa	10 kPa	
For low differential pressure	PSE550	-0.	0 2 kPa	2 kPa 2 kPa			

Rated differential pressure range of sensor
Set differential pressure range of controller

ZSE□ ISE□

PSE

zSE3

PS

ZSP

ISA2

IUAL

IS IZSM

PF2□

IF□

Data